


REFERENCE DRAWINGS:
 AUTOCLAVE HEATER LOCATOR AND DETAIL SEE DWG. SD144E022.
 AUTOCLAVE CONDUIT AND WIREWAY LAYOUT, AUTOCLAVE SECTION @ ELEVATION 108'-6" SEE DWG SE144E020.
 FOR A LIST OF ALL REFERENCES SEE DWG SE144E020.

- NOTES:
1. JUNCTION BOX B-ACLV-JB1 TO BE MOUNTED ON OUTSIDE EDGE OF UPPER WALKWAY AT ELEVATION 116'-1/4" TO THE BOTTOM OF THE BOX.
 2. WALKWAYS AND THEIR SUPPORTS HAVE BEEN DELETED FROM AUTOCLAVE FOR CLARITY.
 3. SOME ELECTRICAL EQUIPMENT HAS BEEN DELETED FROM PRATIAL PLAN FOR CLARITY, SEE DRAWING SE144E020 FOR ADDITIONAL DETAILS.
 4. MANUFACTURER-HORIZONTAL LIGHTS #NHL55-454T5H0-UNV (NB) WITH SYLVANIA #FP54/835/HO/ECO T5 LAMPS SSC.

D-SITE PARTIAL PLAN
 AUTOCLAVE SECTION @ ELEVATION 115'-6"
 (TEST CELL FLOOR EL. 100'-0")
 SCALE 3/4"=1'-0"

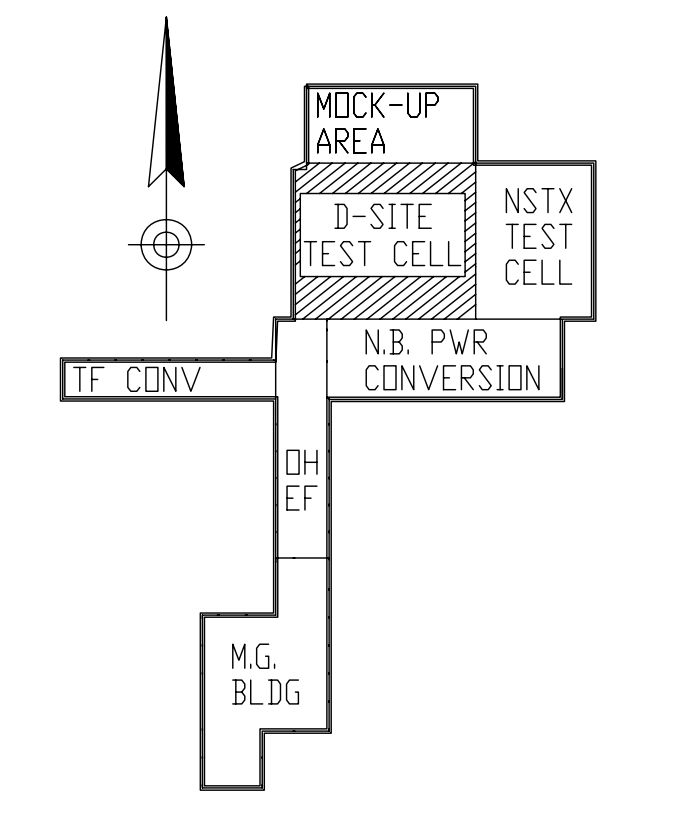

REVISION	BY	CHK	APPROVED	DATE
1	RELOCATED			12/04
2	ECN #481			11/05
3	ECN #5230			3/07

**RELEASED FOR
 FABRICATION / INSTALLATION**

PPPL Drafting:

PRINCETON PLASMA PHYSICS LABORATORY PRINCETON UNIVERSITY NATIONAL COMPACT STELLATOR EXPERIMENT MODULAR COILS TOOLING AND WINDING AUTOCLAVE CONDUIT AND WIREWAY LAYOUT AUTOCLAVE SECTION @ ELEVATION 115'-6"			
DIV: ELECTRICAL	DATE: 2/22/04	CADD FILE: SE144E021R3.DWG	
ENG: FRANK JONES	APPROVED: FRANK JONES	SE144E021	
DWN: FRANK JONES	CHK: JIM NELSON	CHK: J.N.	SHEET OF REV 3

COMPUTER GENERATED
 DRAWING
 MANUAL CHANGES
 NOT PERMITTED
 AutoCAD2000

SE144E021.DWG

Dwg Size
1/4"=1'-0"